

KFB 3060 Flyback
from MTC MTV140
TV SET

Output
0-20KV

POSITIVE
OUTPUT

CAUTION
1000 V
Spikes

HIGH VOLTAGE
POWER SUPPLY
FOR NUSPAR
RESOURCES

GROUND
TERMINAL




THIS
SECTION
ONCE

THIS SECTION REPEATED
5 TIMES


Daniel Frasn
March 16, 1987
Vancouver, B.C.

Nuspa High Voltage Power Supply

NEGATIVE OUTPUT

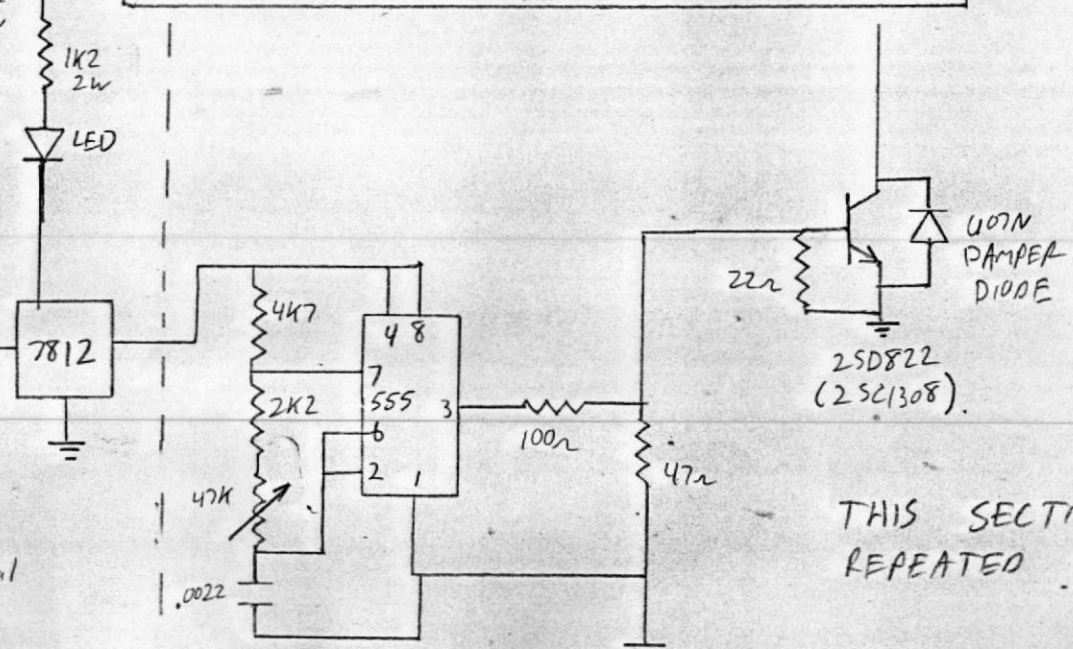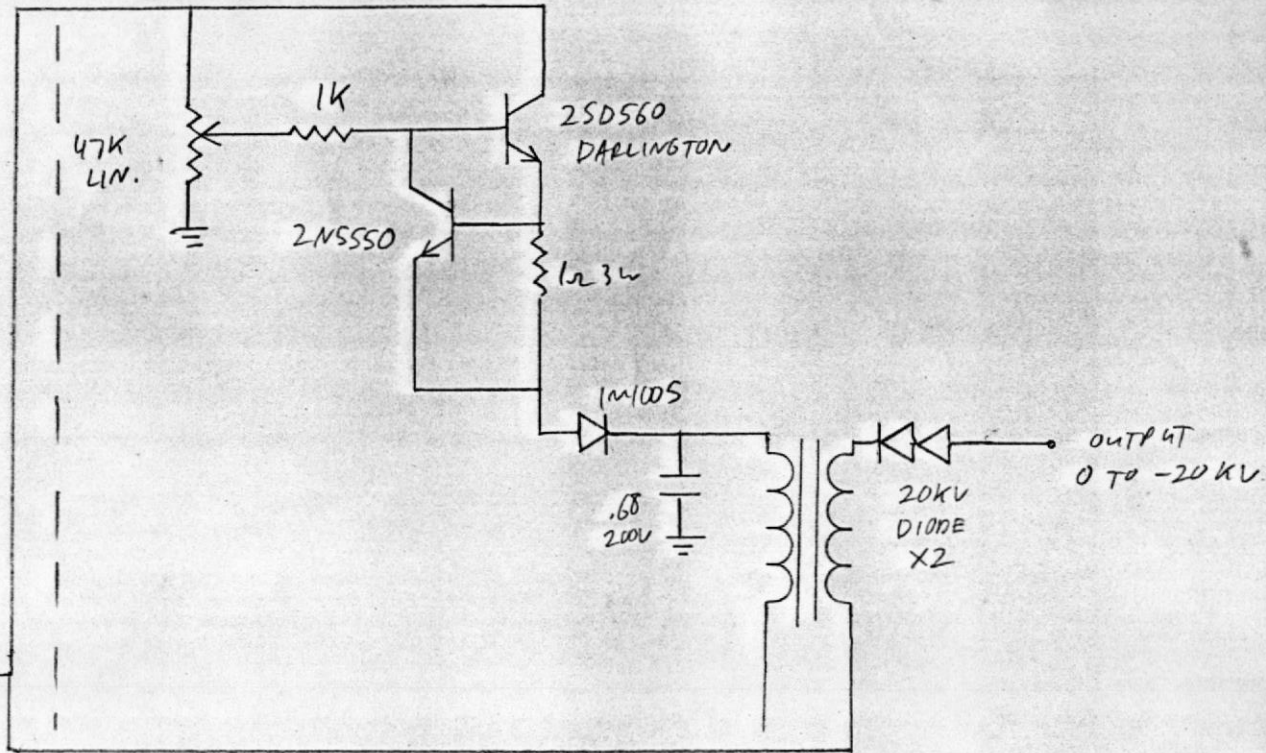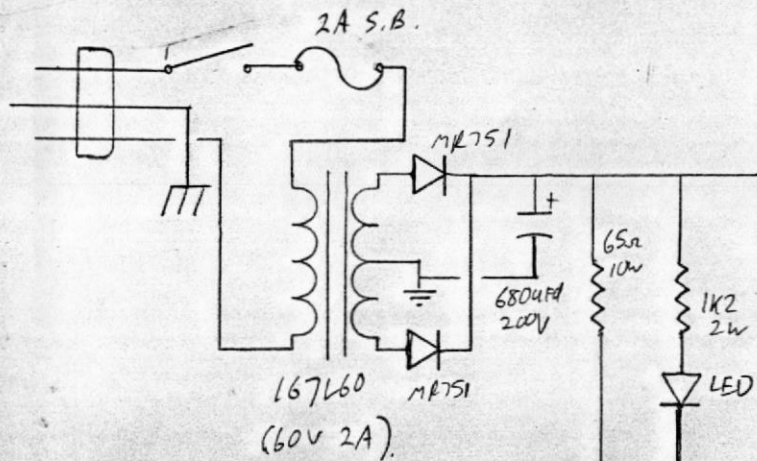

THIS SECTION REPEATED 5 TIMES



David Aron
 June 26/1987
 V P C